


PRELIMINARY PRINT
NOT FOR PUBLIC RELEASE

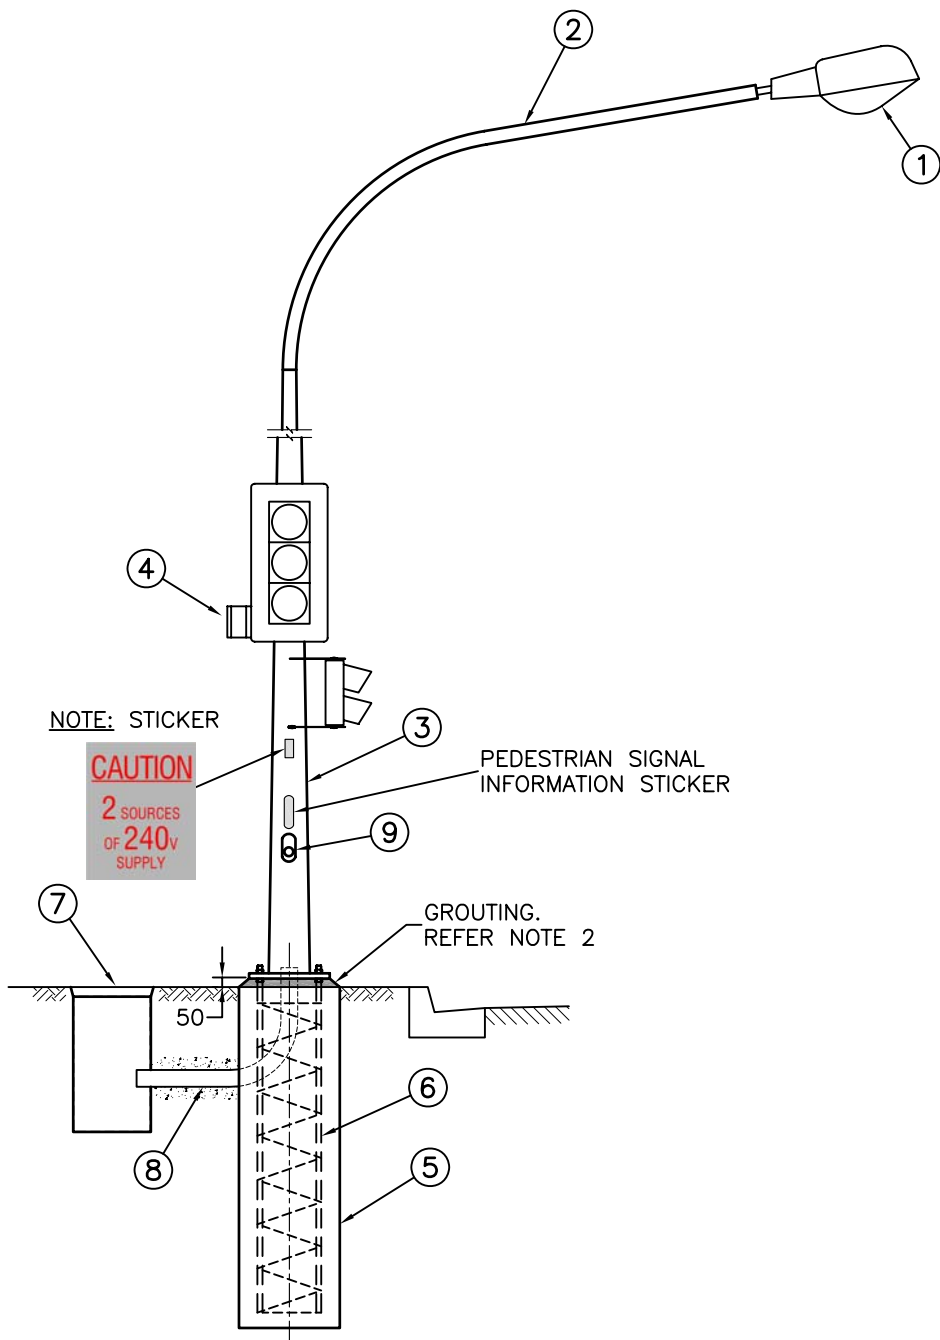

NOTE: STICKER

CAUTION
2 SOURCES
of 240v
SUPPLY

PEDESTRIAN SIGNAL
INFORMATION STICKER

GROUTING.
REFER NOTE 2

ITEM	DESCRIPTION	REFERENCE	ENERGEX APPROVED PRODUCT REFERENCE
1	ROAD LIGHT LUMINAIRE	RATE 2 ENERGEX CONTRACT (SYLVANNIA ROADSTAR)	
		REFER TO APPROVED STREET LIGHT DESIGN	
		S150	5475
2	ROAD LIGHTING POLE OUTREACH ARM	RATE 2 ENERGEX CONTRACT (NB OUTREACHES HAVE 2.0m UPLIFT TO GAIN MOUNTING HT.)	
		S250	5460
		1.5m	5734
		3.0m	5750
3	ROAD LIGHT POLE	RATE 2 ENERGEX CONTRACT	
		7.0 BPM	5637
		8.5 BPM	5639
		10.0 BPM	
4	TRAFFIC SIGNAL JUNCTION BOX	UMS 600/041	
		29 CORE	5438
		36 CORE	
		51 CORE	5439
5	FOOTING	ENERGEX DWG. 4927-A4/2 PAGE 21	
6	ANCHOR CAGE	QLD ENERGY SUPPLY INDUSTRY (QESI) DWG. 05-02-05	
7	ELECTRICAL CABLE JOINTING PIT & LID	MAIN ROADS DWG 1415	
8	100 uPVC HD U/G CONDUIT	STANDARD BCC CONTRACT	
9	PEDESTRIAN PUSH BUTTON UNIT		
	a) PEDESTRIAN PUSH BUTTON UNIT	FROM PUSH BUTTON TO FINIAL (REQUIRED FOR STANDARD PUSH BUTTONS)	
	b) 4-7/0.50 CABLES	FROM PUSH BUTTON TO FINIAL (SUPPLIED WITH AUDIO-TACTILE PUSH BUTTONS)	
	c) FIGURE 8 CABLE	LABEL TO BE PLACED 50mm ABOVE PEDESTRIAN PUSH BUTTON (G9-Q10)	
	d) ADHESIVE LABEL "CROSS WITH CARE"		

PRELIMINARY PRINT
NOT FOR PUBLIC RELEASE

PRELIMINARY PRINT
NOT FOR PUBLIC RELEASE

GENERAL NOTES

- 25mm MAX. HEIGHT OF THREAD TO BE LEFT PROTRUDING ABOVE BASE PLATE LOCK DOWN NUT.
- MIX SAND/CEMENT GROUT IN A 3:1 RATIO BY VOLUME. ADD ENOUGH WATER TO GIVE A WORKABLE MIX. PACK THE MIX BENEATH THE BASE PLATE AND CHAMFER SIDES TO GROUND AT 45°.

ASSOCIATED DOCUMENTS

- ENERGEX PUBLIC LIGHTING MANUAL (CONSTRUCTION)
- ENERGEX PUBLIC LIGHTING MANUAL (POLICY)
- ENERGEX APPROVED PRODUCTS LIST (FORM 2020)

REFERENCED DOCUMENTS

STANDARD DRAWINGS:

- UMS 600/012: 'TRAFFIC SIGNAL/LIGHTING POLE ELECTRICITY SUPPLY WARNING LABELS'.
- UMS 600/041: 'TRAFFIC SIGNAL JUNCTION BOX'.
- ENERGEX DWG. 4927-A4/2 PAGE 21: 'MAJOR ROAD, BASE PLATE MOUNTED POLE, FOUNDATION DETAIL, MAX MOUNTING HEIGHT 15.0m'.
- QLD ENERGY SUPPLY INDUSTRY (QESI) DWG. 05-02-05: 'PUBLIC LIGHTING HARDWARE, ROAD LIGHTING POLE, FOUNDATION ASSEMBLY (BPM & SBM), MAJOR ROAD'.
- MAIN ROADS DWG. 1415: 'TRAFFIC SIGNALS/ROAD LIGHTING - CIRCULAR CABLE JOINING PIT - 600 DIAMETER'.

PRELIMINARY PRINT
NOT FOR PUBLIC RELEASE

PRELIMINARY PRINT
NOT FOR PUBLIC RELEASE

ISSUE	AMENDMENT	DRAWN DATE	CHK'D DATE	APPR'D DATE
D	Req. for Item 8 Mod., Grout Req. Added.	DL 09/11		
C	Dwg No. Changed, Street Light Supply Box Removed, Conduit Size Amended.	Nov '09	IC 01/11	PC 01/11
A-B	Refer Previous Revisions for Detail.	04/01 - 11/04	05/01 - 02/05	06/01 - 02/05

DESIGN AUTHORISED FOR ISSUE B. BALL SIGNATURE ON ORIGINAL DATED 29/6/01				DESIGN	STD DWG GROUP	DATE	April '01
MANAGER ASSET SUPPORT - R.P.E.Q. 3 8 5 2				DRAWN	CITY DESIGN	DATE	April '01
DESIGN APPROVED K. MEMORY SIGNATURE ON ORIGINAL DATED 27/6/01				CHECKED	R. WILSON	DATE	May '01
SENIOR PROGRAM OFFICER NETWORK OPERATIONS - R.P.E.Q. 4 7 6 1				DRAWING FILENAME	UMS 600_054		
				ASSOCIATED PLANS	Previous Dwg No. UMS 644		



BRISBANE CITY COUNCIL STANDARD DRAWING

**JOINT USE TRAFFIC SIGNAL
AND ROAD LIGHTING POLE
(RATE 2)**

SCALE NOT TO SCALE	
Dwg No. UMS 600/054	
ORIGINAL SIZE A3	REVISION D